


LAMP	VOLTAGE	FUSE SIZE
100 WATTS 9,500 LUMENS	120 Volts 240 Volts	8 Amps 5 Amps
250 WATTS 30,000 LUMENS	120 Volts 240 Volts	10 Amps 5 Amps

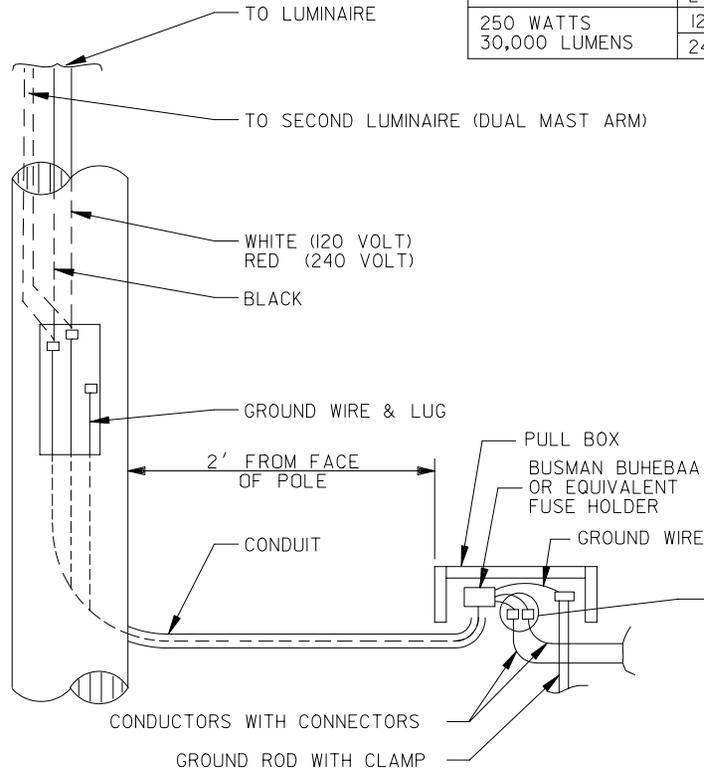


CONNECTION DETAIL


CONNECTORS WIRENOTS/
TERMINAL ENDS TO BE
SILICON FILLED OR
APPROVED EQUAL.

NOTES:

1. ALL PULL BOXES SHALL BE A.D.O.T. TYPE 3-1/2, OR APPROVED EQUAL.
2. ALL PULL BOXES SHALL BE PROVIDED BY THE UTILITY COMPANY,
3. NO PULL BOXES SHALL BE INSTALLED IN SIDEWALK RAMPS.
4. FOR INSTALLATIONS IN APS AREA, A BUSMAN TYPE 15 AMP FUSE IS REQUIRED IN THE J-BOX AND A 10 AMP INLINE FUSE IN THE HANDHOLE.

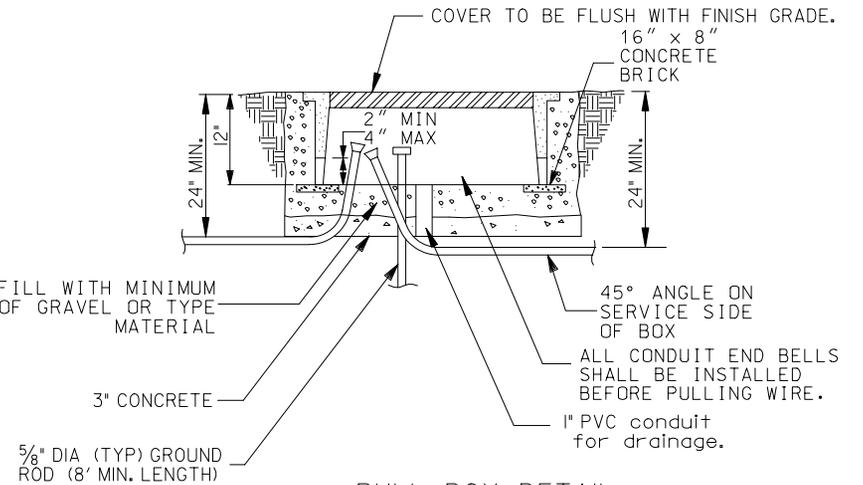

PULL BOX DETAIL

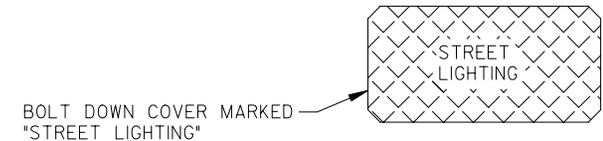

COVER DETAIL

ORIGINAL SIGNATURE ON FILE
AT THE CITY OF TEMPE

APPROVED: _____ DATE
PUBLIC WORKS MANAGER

APPROVED: _____ DATE
DEPUTY PUBLIC WORKS MANAGER
CITY ENGINEER

