



PWR. CONDUIT TO J-BOX
SEE DTL. T-654, SHT 3 OF 11

LIGHTING POWER CONNECTION

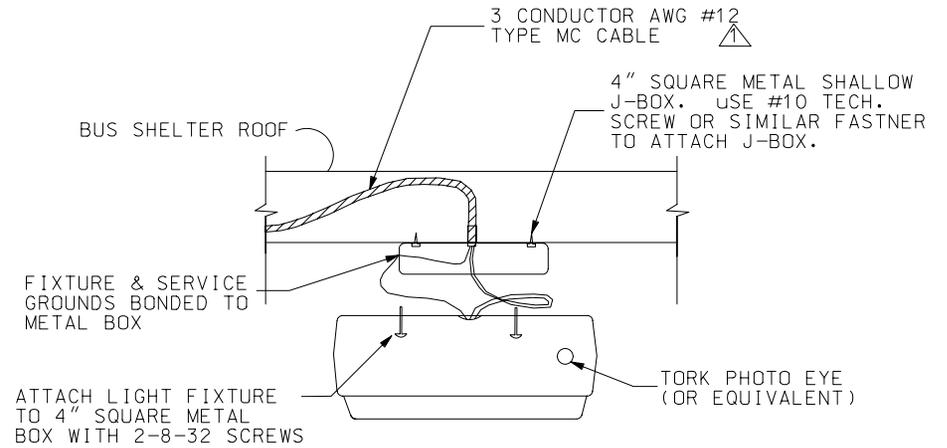

LIGHTING FIXTURE CONNECTION

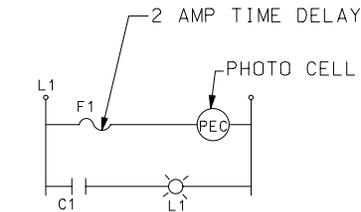

TRANSIT SHELTER LIGHTING SCHEMATIC
120 V AC Ø

NOTES:

- ⚠ TYPE MC CABLE TO BE INSTALLED AS PER N.E.C. ARTICLE 334
- ⚠ (2) AMP, TIME DELAY, SINGLE TRIP FUSE. TYPE LITTLE FUSE LGR/LMF OR EQUIVALENT.
- ⚠ ALL GROUNDING WILL BE INSTALLED IN COMPLIANCE WITH ARTICLE 250 OF THE NATIONAL ELECTRICAL CODE.

APPROVED: _____ DATE _____
ORIGINAL SIGNATURE ON FILE AT THE CITY OF TEMPE
 DEPUTY PUBLIC WORKS MANAGER TRANSPORTATION

APPROVED: _____ DATE _____
 DEPUTY PUBLIC WORKS MANAGER CITY ENGINEER