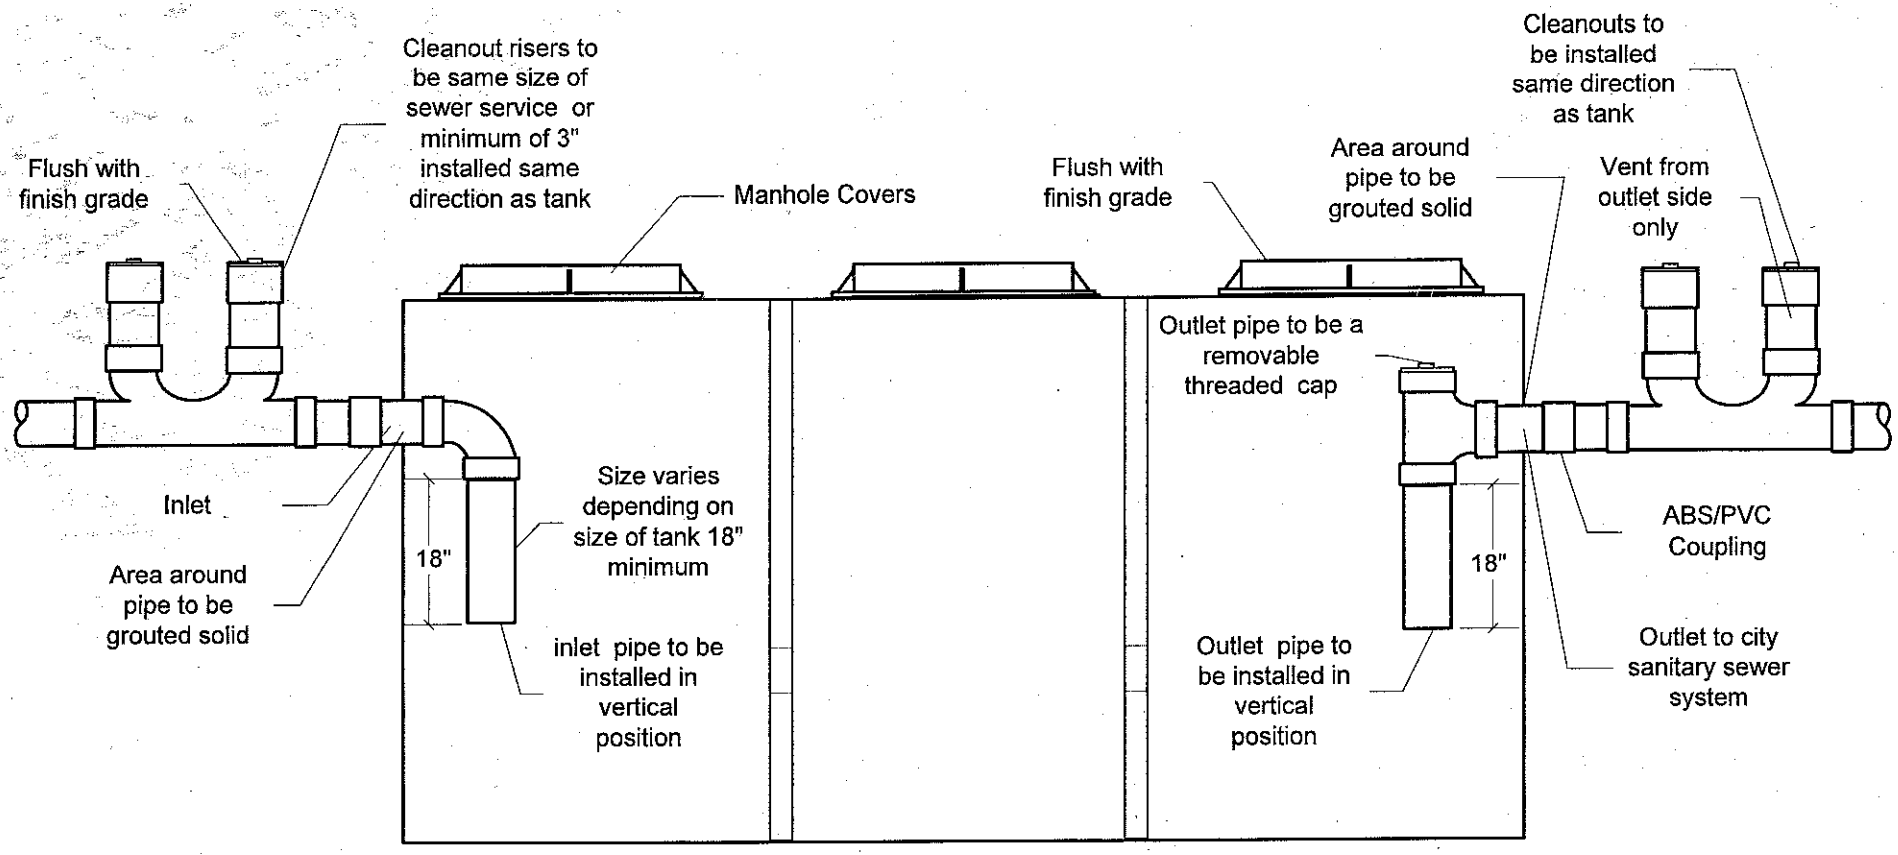

Call City of Tempe for Inspection, Prior to Back Filling
(480) 350-2678

Note: 750 gallon Interceptors shall have three chambers and manhole opening for each chamber