


Control Manhole / Sample Collection Point

In accordance with the Tempe City Code, §27-176, a "control manhole" is required to be installed as close as practical to the City of Tempe right-of-way, on the private property, on each connection point to sanitary sewer.

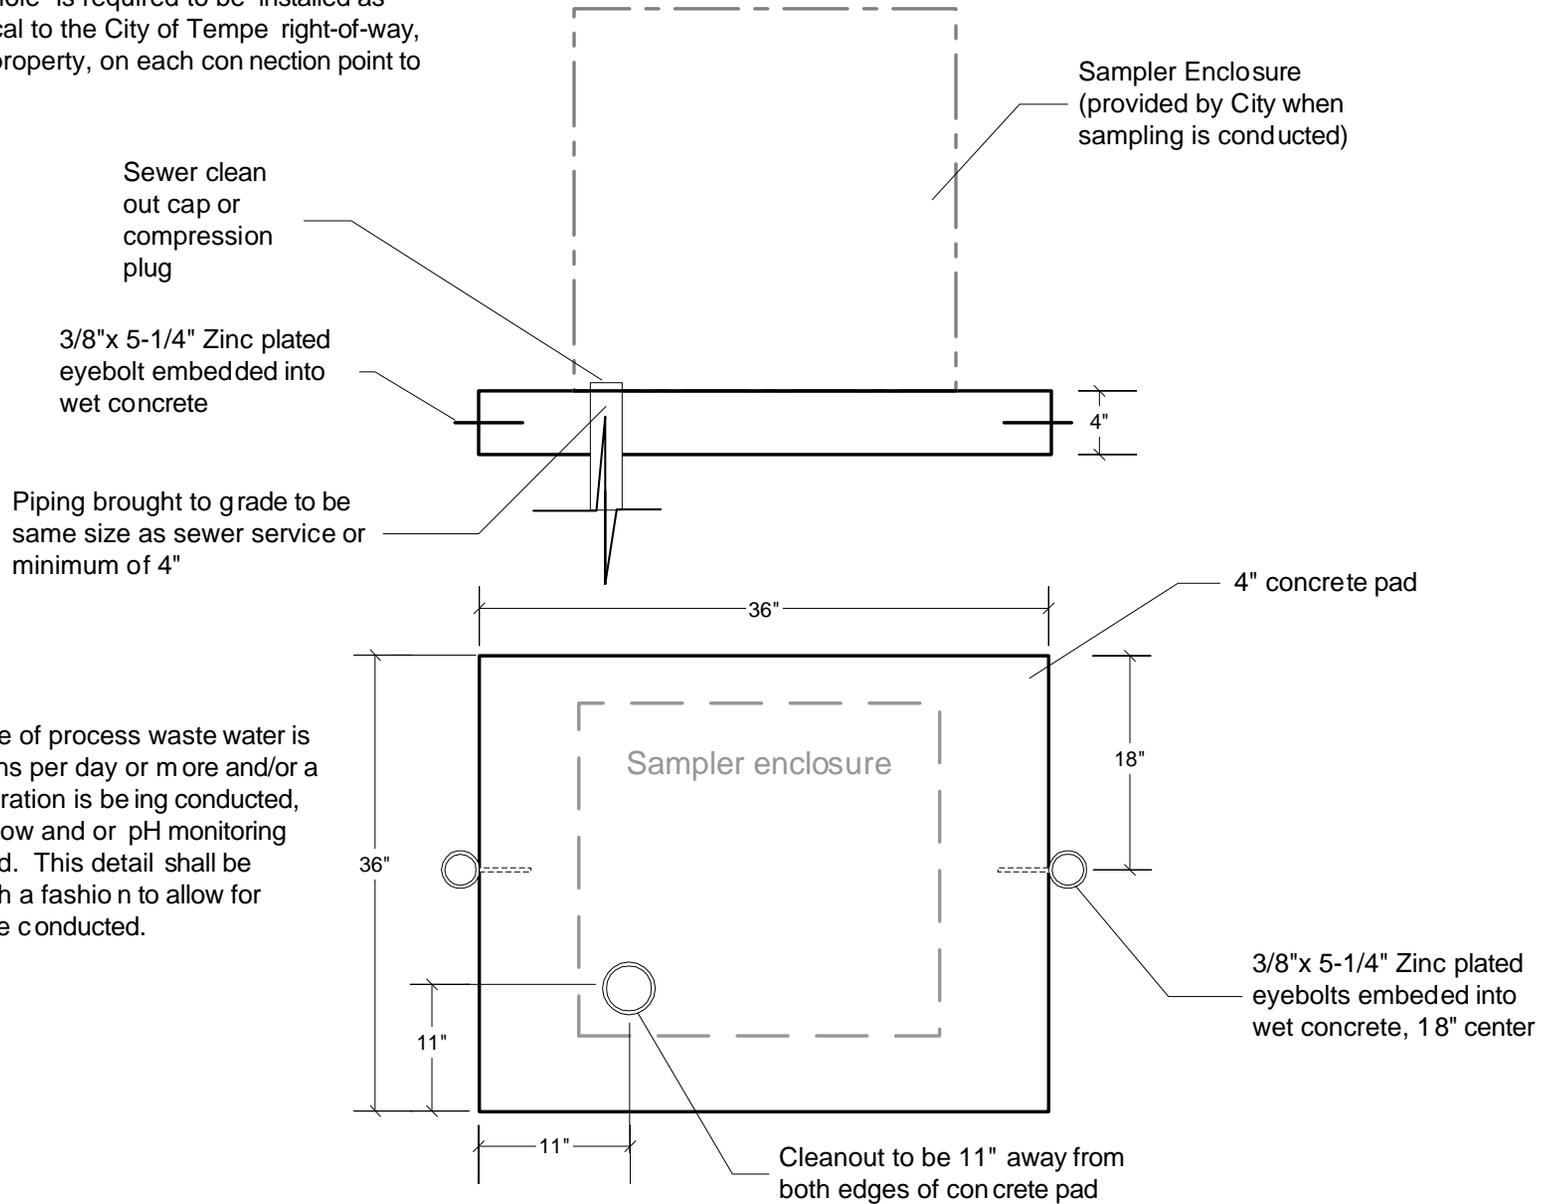

NOTE:

When discharge of process waste water is at 25,000 gallons per day or more and/or a categorical operation is being conducted, open channel flow and or pH monitoring may be required. This detail shall be modified in such a fashion to allow for monitoring to be conducted.

Example of Control Manhole installed on existing 6" Clay Sewer.
Measurements on drawings are for example purposes only.

